


For Spans 24'-0" Or Less

Box Culvert Sections Are To Be Manufactured To ASTM C-1433 Specifications As Required.

Joints To Be Sealed w/ Mastic And Wrapped w/ 22" Wide Filter Fabric.

Inlets And Outlets To Penetrate Through End Caps To Maintain Structural Integrity Of The Box Culvert.

Span, Rise And Length Of Retention Chamber To Be Determined By Required Capacity.

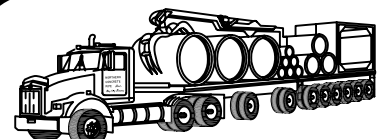

Northern Concrete Pipe, Inc.
 401 Kelton Street Bay City, MI 48706 1 800 222 9918
 5281 Lansing Road Charlotte, MI 48813 1 800 874 9701

Typical Precast Concrete Box Retention System				
Date	Revised	Drawn By	Scale	
20 Nov 00	12 May 05	BmG	NTS	7.3