


Box Culvert Sections Are To Be Manufactured To ASTM C-1433 Specifications As Required.


Joints To Be Sealed w/ Mastic And Wrapped w/ 22" Wide Filter Fabric.

Inlets And Outlets To Penetrate Through End Caps To Maintain Structural Integrity Of The Box Culvert.

Span, Rise And Length Of Retention Chamber To Be Determined By Required Capacity.

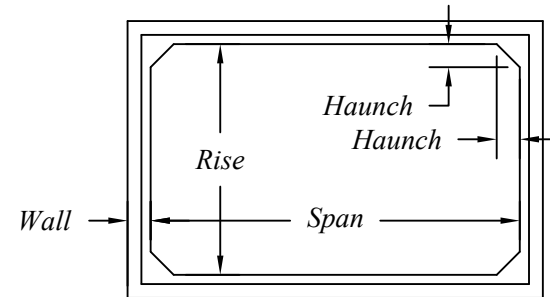

For Spans 24'-0" Or Less

	401 Kelton St Bay City, MI 48706		Typical Precast Concrete Box Retention System			
	5281 Lansing Rd Charlotte, MI 48813	2701 Chicago Dr SW Wyoming, MI 49519				
	4950 White Lake Rd Clarkston, MI 48346	3756 Centennial Rd Sylvania, OH 43560	Date 16 May 16	Revised	Rev. No.	Drawn By BmG
07.03						